


Klik [hier](#) voor video tutorial om de unit van Type R om te bouwen naar Type L

EN

Airobot V4/V6 duct position change to the Type L

If you use device as type R then do not do any modifications only mobile app configuration ☒

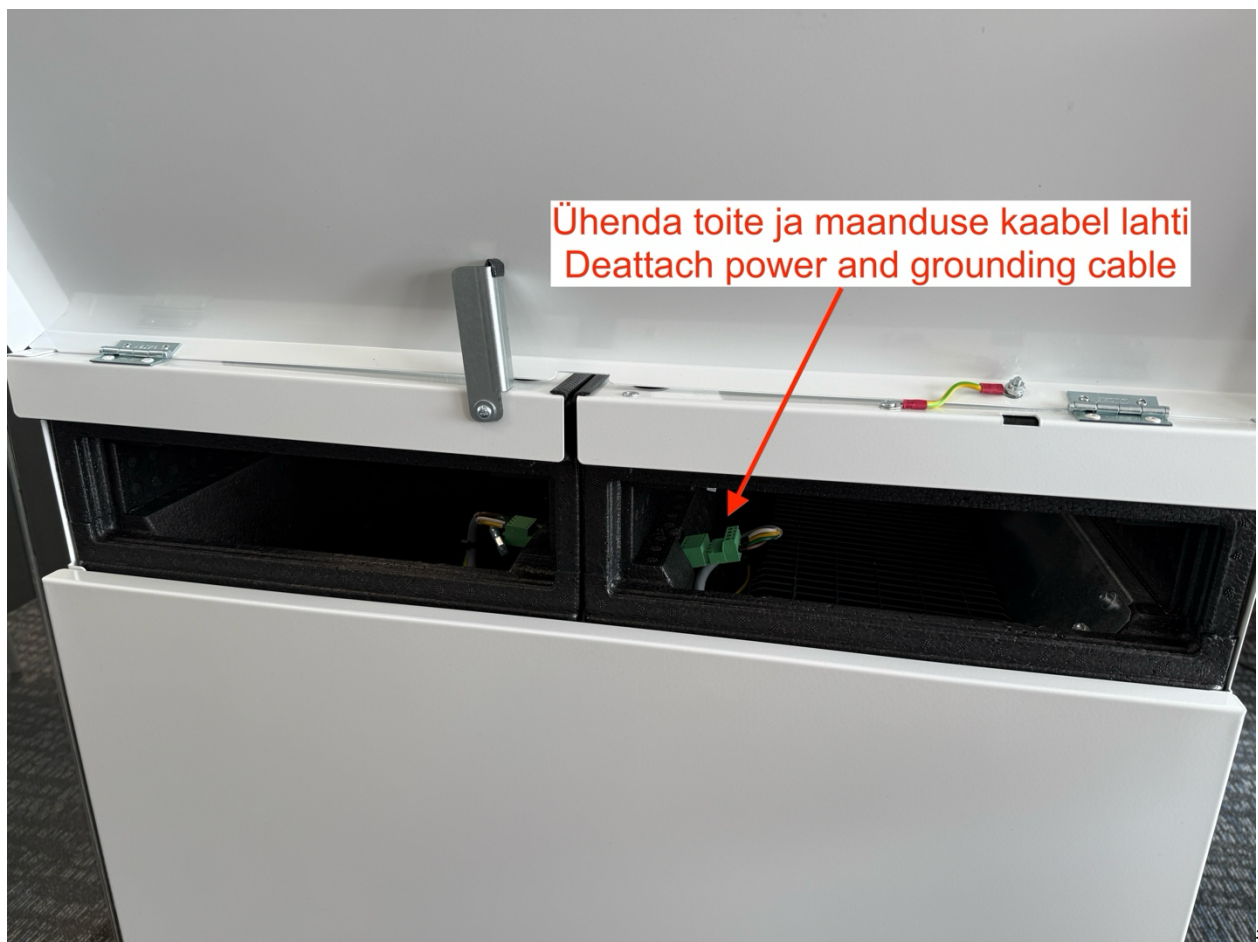



Ühenda toide ja maandus küttekeha pistikuga kokku
Connect power and grounding with heater wires




Eemalda küttekeha parempoolsest kambri
Remove heater from the right chamber




Eemalda toitejuhe lahti pistikust ja paigalda küttekeha vasakule poole
Deattach power from the socket and place heater to the left side



Eemalda õhukvaliteedi andur vasakult poolt
Remove air quality sensor from the right side

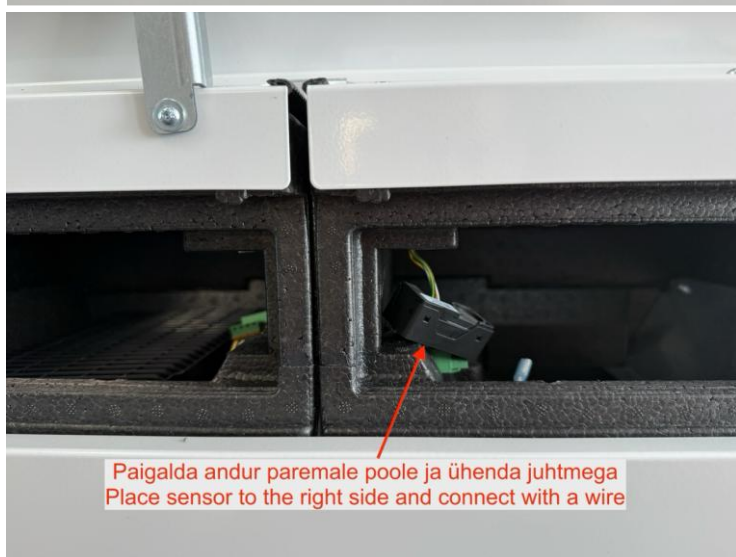


Paigalda andur paremale poole ja ühenda juhtmega
Place sensor to the right side and connect with a wire

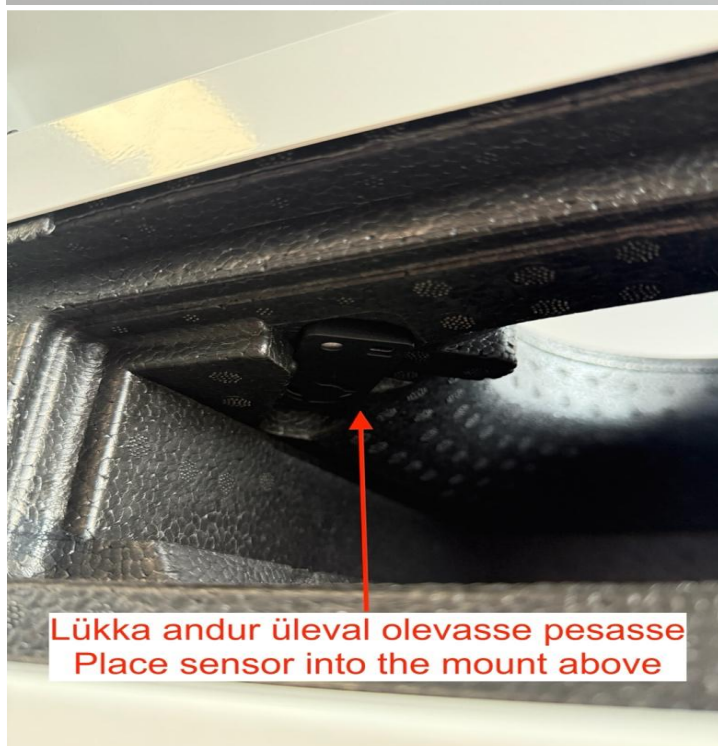

Lükka andur üleval olevasse pesasse
Place sensor into the mount above



F7 filter paigalda vasakule poole
F7 filter place to the left side

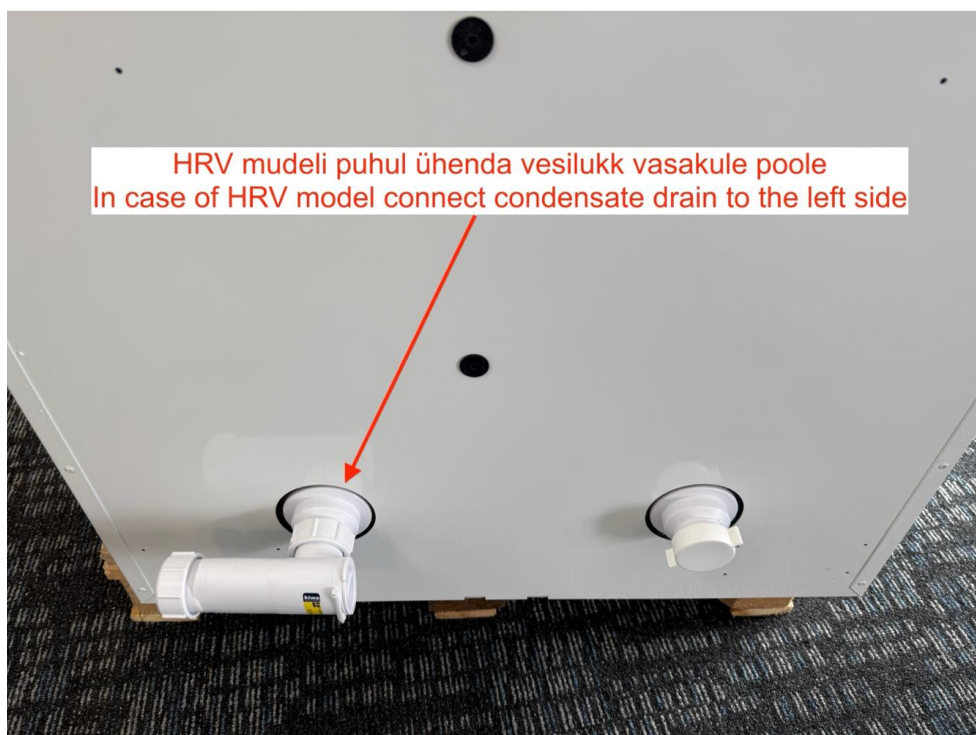

HRV mudeli puhul ühenda vesilukk vasakule poole
In case of HRV model connect condensate drain to the left side

EN

Choose device type, there are 2 options for that:

Option 1: Select device type with remote control. When starting the device, the device type selection screen will appear and select the type.

Option 2: Select device type with mobile app. Connect to the connected ventilation device and select the type

